


**Crossing and Proximity Specifications for Crossroads
High Pressure Gas Line (more than 689 kPa, 100 psi)**

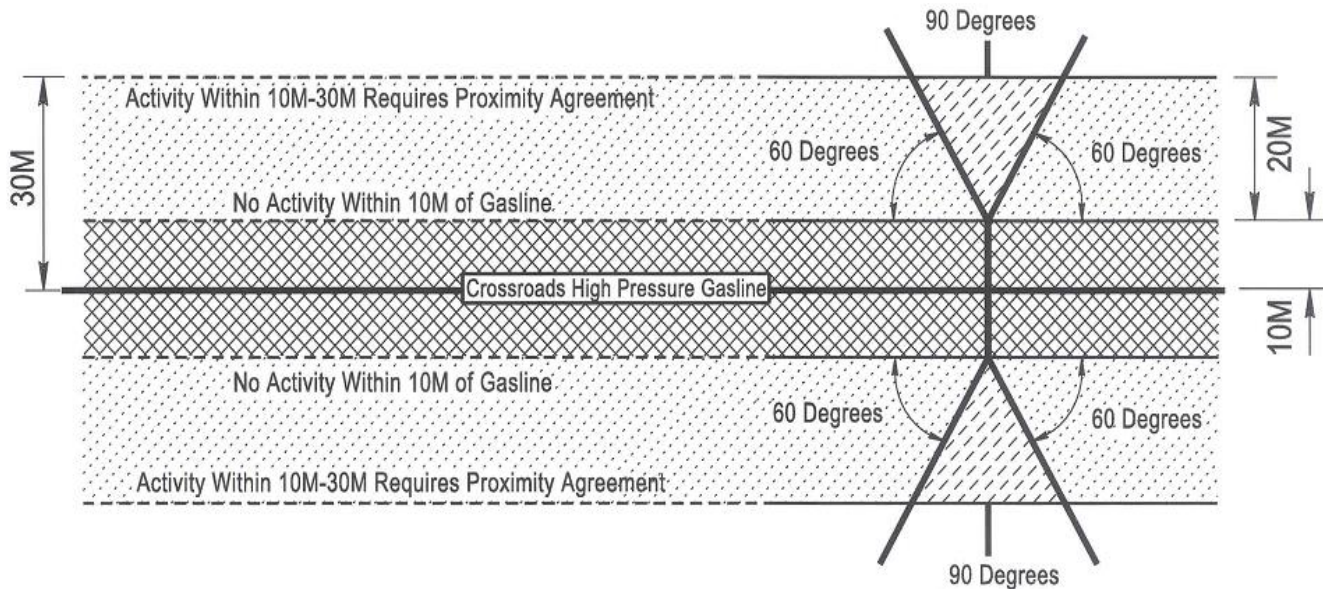

1. A *Crossing Agreement* is required for crossings (pipe, road, etc.) and must maintain a minimum of a 90 degree angle to the Crossroads gas line within 10 meters of the Crossroads' gas line.
2. A *Crossing Agreement* and a *Proximity Agreement* are required for crossings (pipe, road, etc.) that do not maintain a 60 degree angle to the Crossroads gas line between 10 meters and 30 meters of the Crossroads gas line.
3. Any activity not crossing the Crossroads gas line must maintain a minimum of 10 meters from the Crossroads gas line.
4. Any activity within 10 to 30 meters of the Crossroads gas line, requires a *Proximity Agreement*. This applies to any lease, road, facility, pipeline, etc. regardless of where it is placed in the Right-Of-Way.
5. The following is a partial list of activities requiring a *Crossing Agreement* and/or a *Proximity Agreement*:

a. Lease	e. Right of way	i. Drag space
b. Well	f. Road	j. Equipment travel
c. Fence	g. Meter station	k. Equipment storage
d. Pole Placement	h. Work space	l. Any ground disturbance

OR any other activity reasonably deemed to require an agreement.